CLASS OF WORK	ADDRESS	NUMBER OF CARDS	DATE	DESCRIPTION
2	320 ROMA NE	23/35	2/78	MECH DET

DIST

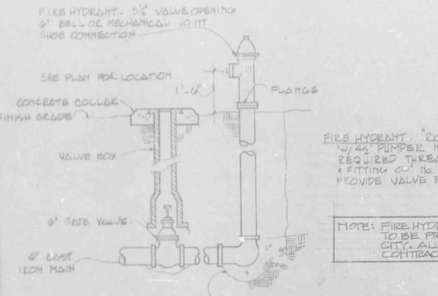

FIRE HYDRANT DETAILS

NOT TO SCALE

FIRE HYDRANT: 'KUH VALVE CO.' MODEL NO. 665-BB 'VANGUARD 600' W/ 4½" PUMPER NOZZLE AND TWO 2½" THREADED NOZZLES. VERIFY REQUIRED THREADING W/ LOCAL FIRE DEPT. PROVIDE M.J. VALVE & FITTING O.D. TO 6"x 6" SIZE GATE VALVE SHOES OF FIRE HYDRANT. PROVIDE VALVE BOX AND EXTENSIONS TO GRADE. (SEE DETAILS).

NOTE: FIRE HYDRANT & CONSTRUCTION TO BE PROVIDED & INSTALLED BY CITY. ALL FEES TO BE PAID BY CONTRACTOR.

NOTE:
ENCASE ALL SHEETMETAL DUCTWORK OR FITTINGS BELOW SLAB IN 6 MIN. OF 3/4 CONC.

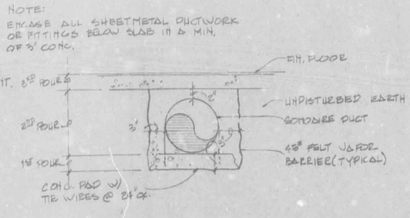

UNDERFLOOR DUCT DETAIL

NOT TO SCALE

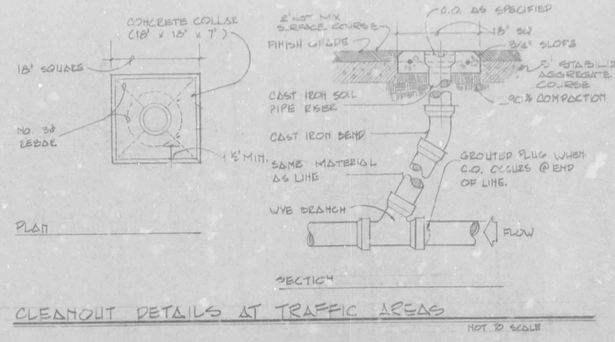

CLEANOUT DETAILS AT TRAFFIC AREAS

NOT TO SCALE

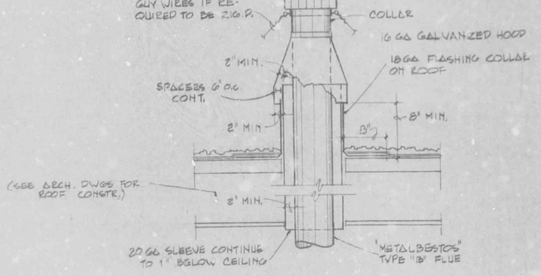

TYPICAL FLUE DETAIL

NOT TO SCALE

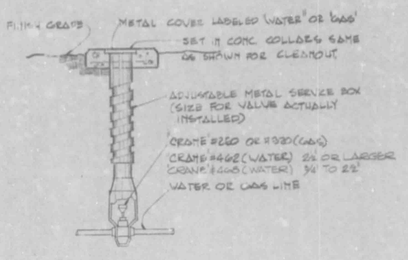

SERVICE STOP DETAIL

NOT TO SCALE

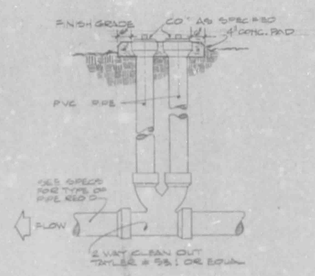

DOUBLE CLEAN OUT

NOT TO SCALE

CITY OF ALBUQUERQUE

The microimage of this document is certified to be an accurate copy of the original document as it appears in the files of the BUILDING AND INSPECTION DIVISION

Mary Lou Cooper, City Clerk/Recorder

CITY OF ALBUQUERQUE
NEW MEXICO
BUILDING SAFETY

DRAWN BY

SHEET TITLE

PROJECT

MITCHELL & WRIGHT ARCHITECTS

22"
17"
11"
8.5"

CITY OF ALBUQUERQUE